


- REQUIREMENTS:
- 1 - 100'-10" GROUP (INCLUDING END RAILS)
 - 12 ROWS
 - 10" RISE
 - 24" SPACING
 - WALL ATTACHED FRICTION POWER OPERATION W/PENDANT CONTROL

- 11 IN. DECK LEVEL REAR FILLER
- 10 IN. PLASTIC SEAT MODULES
- 3 - 48" FOOTREST LEVEL AISLE(S) W/ NON-SLIP TREAD REMOVABLE CENTER HANDRAILS INTERMEDIATE AISLE STEPS HINGED FRONT STEP

- 2 - SELF STORING END RAIL(S) (STARTING AT ROW 2) ROW & SEAT ID PLATES
- 6 - 36" x 24" PERMANENT WHEELCHAIR SPACES W/ FIXED FRONT RAILS

- SEATING CAPACITY:
 680 SEATS @ 18" PER SEAT
 6 WHEELCHAIR SPACES @ 36"

NOTES:
 ALL VERIFIABLE DIMENSIONS ARE SUBJECT TO CHANGE PENDING FIELD VERIFICATION
 FLOOR SHALL BE SMOOTH AND LEVEL, WITH SLOPE NOT TO EXCEED 1/8" IN 10 FT. (ALTERNATIVELY RECOMMEND FFS0/FL35)
 IF WALL COLUMNS OR OTHER OBSTRUCTIONS EXIST IN PROPOSED BLEACHER AREA, VERIFY TYPE, LOCATION, WIDTH, & DEPTH AT FLOOR AND AT LAST ROW SEAT HEIGHT

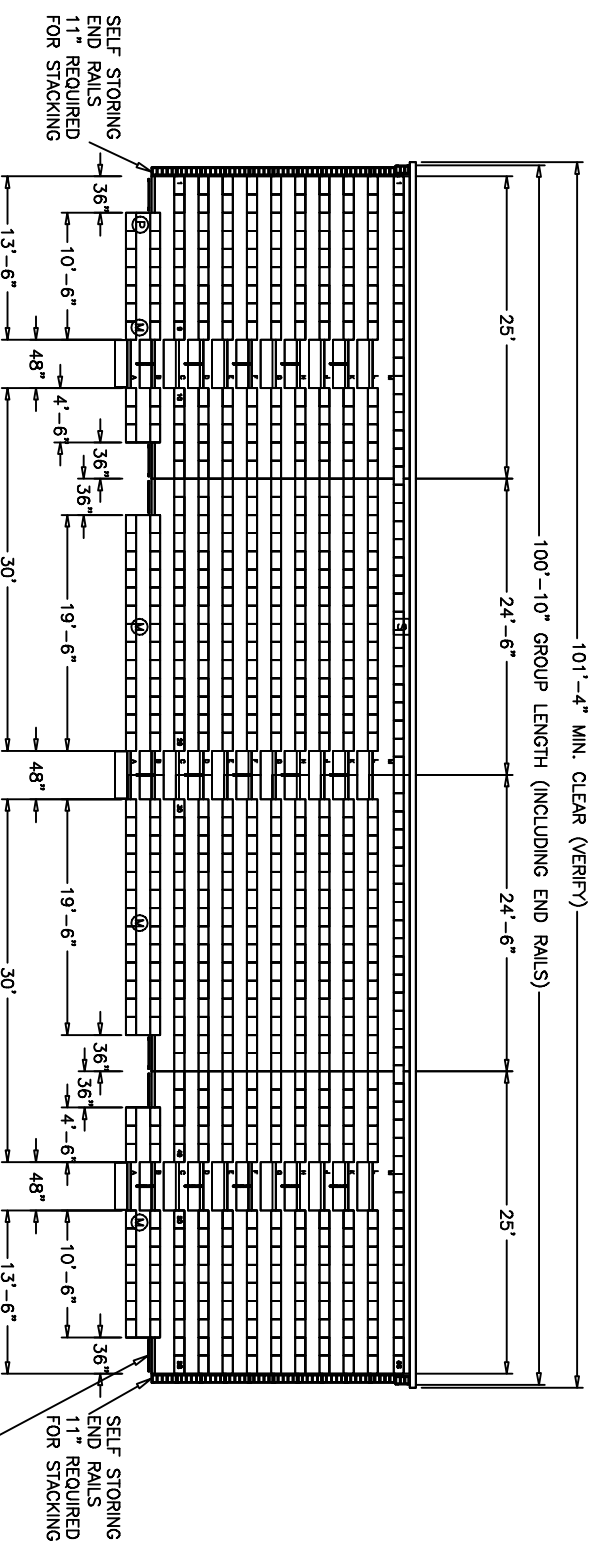

- LEGEND:
- (M) - MOTOR LOCATION
 - (P) - PENDANT LOCATION ON SKIRT
 - [S] - POWER SOURCE (4'-0" A.F.F.) 120 VAC SINGLE-PHASE 60 HZ, 30 AMP SERVICE CAPABLE OF SUPPORTING UP TO 6 - 1/4 Hp MOTORS RATED AT 4 FLA EACH, 3 WIRE NEUTRAL AND GROUND MUST BE PROVIDED TO SOURCE

- READILY ACCESSIBLE DISCONNECTION BOX AND WIRING (AS REQUIRED BY N.E.C. - SUPPLIED AND LOCATED BY OTHERS)

FINISHES:
 PANELAM DECKING: 37 GREY
 GALVANIZED STEEL: MINIMUM G-60
 PLASTIC COLOR: 13 ORANGE

NO.	REVISION	DATE BY	ISSUED FOR	DATE BY

MODEL 4500

SCALE	3/8" = 1'
DATE	02/24/2009
DESIGNER	
CHECKER	
DATE	
REVISION DATES	
GROUP	Group A
REV.	0

ALTHOUGH BUILDING CODES MAY VARY, THIS DRAWING IS INTENDED TO BE IN COMPLIANCE WITH BUILDING CODES.